



ALTERNATE MATERIALS MUST BE APPROVED BY THE CITY OF NAPA WATER DIVISION PRIOR TO USE

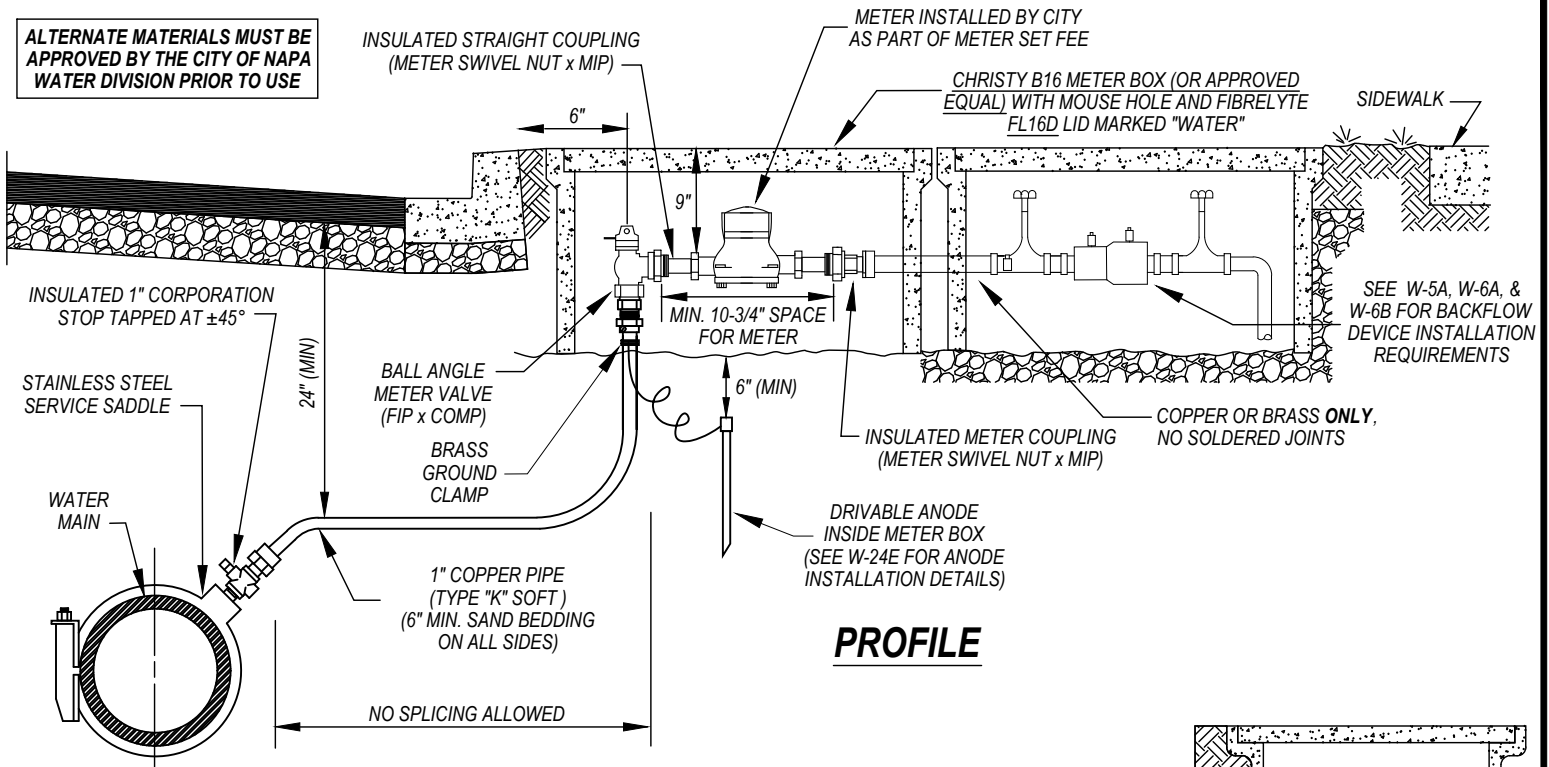

PROFILE

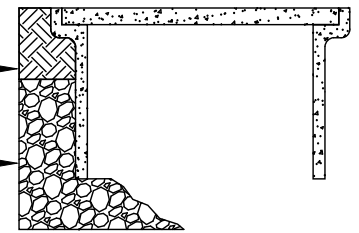

DETAIL

METER BOX INSTALLATION

APPROVED FITTINGS	
DESCRIPTION	MUELLER
BRASS METER IDLER	H-10887
BALL ANGLE METER VALVE (FIP x COMP)	B-24274
INSULATED CORPORATION STOP (MIP x COMP)	N-35028**
INSULATED STRAIGHT COUPLING (METER SWIVEL NUT x MIP)	H-10871**
STAINLESS STEEL SERVICE SADDLE (SMITH-BLAIR #372, FORD #300, JCM #502)	

** SHALL BE INSULATED FITTINGS BY MUELLER OR JONES

NOTES

- OBSTRUCTIONS:** METERS SHALL BE PLACED 3-FT MIN. FROM ANY OBSTRUCTION (SIGNS, FENCES, MAILBOX, ETC.). METERS SHALL BE INSTALLED 10-FT MIN. FROM TREES (5-FT MIN. FROM SHRUBS). SEE W-18 FOR ADDITIONAL DETAILS.
- WATER-SEWER SEPARATION:** WATER-SEWER (OR WATER-RECYCLED WATER) SEPARATION SHALL COMPLY WITH ALL STATE WATER RESOURCES CONTROL BOARD REQUIREMENTS. WATER SERVICES SHALL BE 10-FT MIN. (PARALLEL) AND 1-FT MIN. ABOVE (PERPENDICULAR) ALL SEWER (OR RECYCLED WATER) MAINS. SEE W-22 FOR SEPARATION REQUIREMENTS.
- HOT-TAP:** HOT-TAPS TO ACTIVE WATER MAINS SHALL BE MADE BY CITY FORCES AT APPLICANT'S EXPENSE. SEE W-16 FOR HOT-TAP REQUIREMENTS. HOT-TAP SHALL BE INSTALLED 36" MIN. FROM ANY TAP, BELL, FITTING, WATER SERVICE, ETC.
- METALLIC PIPE AND FITTINGS:** BURIED SECTIONS SHALL BE WRAPPED WITH AN 8-MIL PLASTIC SLEEVE. COPPER PIPE NOT WRAPPED IN A PLASTIC SLEEVE SHALL BE NSF 61 APPROVED PLASTIC COATED COPPER TUBING (TYPE "K" SOFT BLUE IN COLOR). INSULATED COUPLING SHALL BE WRAPPED WITH 10-MIL HIGH TACK PIPE WRAP TAPE 3-FT MIN. TO EACH SIDE OF THE INSULATION POINT.
- METER BOX AND SERVICE LINE INSTALLATION:** INSTALL 3-FT MIN. OUTSIDE ANY VEHICULAR ACCESS WAY.
- CURB ADJACENT SIDEWALK:** INSTALL THE METER AT BACK OF CURB AS SHOWN. INSTALL BACKFLOW DEVICE BEHIND SIDEWALK.
- BACKFLOW PREVENTION DEVICES:** APPROVED DEVICES SHALL BE INSTALLED AND TESTED AND WATER METERS SHALL BE SET, PRIOR TO ANY USE OF WATER SERVICE. USE OF JUMPERS, HOSE BIBS, OR OTHER DEVICES SHALL NOT BE PERMITTED.
- TWO OR MORE SERVICES:** INSTALLATION OF TWO OR MORE SERVICES REQUIRE CONNECTION OF PERMANENT ADDRESS TAGS FOR EACH METER WHICH SHALL BE DURABLY FIXED TO THE METER PRIOR TO WATER SERVICE ACTIVATION.
- WATER SERVICE SIZE:** ALL WATER SERVICES SHALL BE APPROPRIATELY SIZED FOR THE INTENDED USE. THE WATER DIVISION RESERVES THE RIGHT TO REQUIRE A WATER SERVICE ANALYSIS TO EVALUATE DEMANDS AND THE APPROPRIATENESS OF THE SERVICE SIZE(S). UNDERSIZED WATER SERVICES ARE PROHIBITED.

CITY OF NAPA

UTILITIES DEPARTMENT

TITLE	
3/4" AND 1" WATER SERVICE	

DRAWN BY:	DF
APPROVAL DATE:	09/2021
SCALE:	NTS
REVISED DATE:	09/2021

CHECKED BY:	SL
APPROVED BY:	DD
DRAWING NO.	W-1