


ALL JOINTS SHALL BE RESTRAINED.
 BURIED FITTINGS: MEGALUG,
 RESTRAINTS, OR EQUAL
 EXPOSED FITTINGS: FLANGED,
 MEGALUG, OR VICTAULIC JOINTS

**ALTERNATE MATERIALS MUST BE
 APPROVED BY THE CITY OF NAPA
 WATER DIVISION PRIOR TO USE**

**FLANGETYTE GASKETS BY U.S. PIPE SHALL
 BE USED FOR ALL FLANGED FITTINGS.**

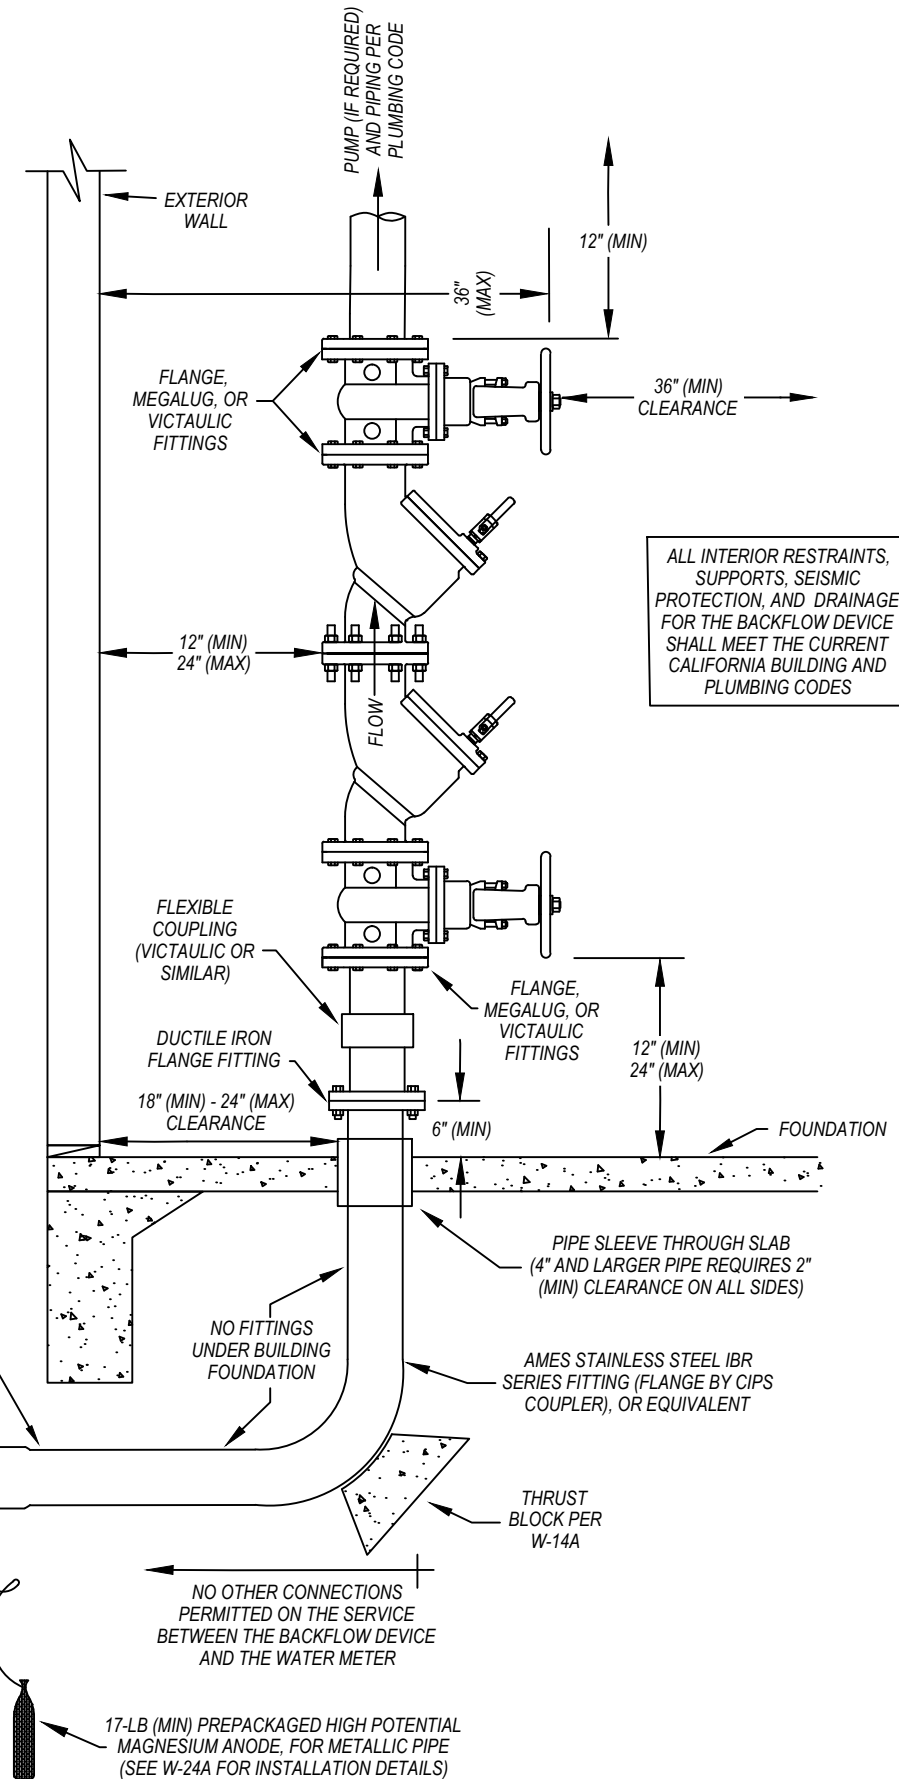

CITY OF NAPA

PUBLIC WORKS DEPARTMENT

TITLE **INTERIOR DOUBLE CHECK VALVE
 BACKFLOW DEVICE INSTALLATION FOR
 3" TO 8" RESIDENTIAL WATER SERVICES**

DRAWN BY: DCF
 DATE: 07/2017
 SCALE: NTS
 FIELD NOTES:

CHECKED BY: MJH
 APPROVED BY: MJH
 DRAWING NO. W-5D.1