



**EXISTING OR PROPOSED WATER MAINS, 12" AND LARGER**

(MEASURED FROM OUTER EDGE OF WATER MAIN TO OUTER EDGE OF OTHER UTILITY)

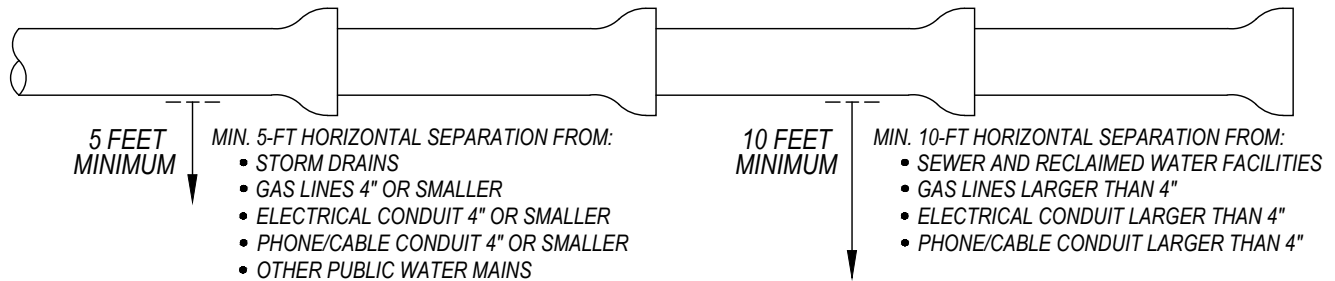


**EXISTING OR PROPOSED WATER MAINS, 8" AND SMALLER**

(MEASURED FROM CENTERLINE OF WATER MAIN TO OUTER EDGE OF OTHER UTILITY)

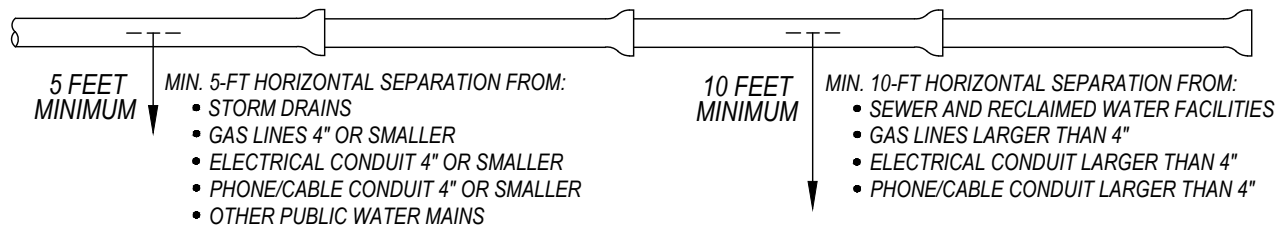

**EXISTING OR PROPOSED WATER SERVICE AND FIRE HYDRANT LATERALS**

(MEASURED FROM CENTERLINE OF WATER LATERAL TO OUTER EDGE OF OTHER UTILITY)

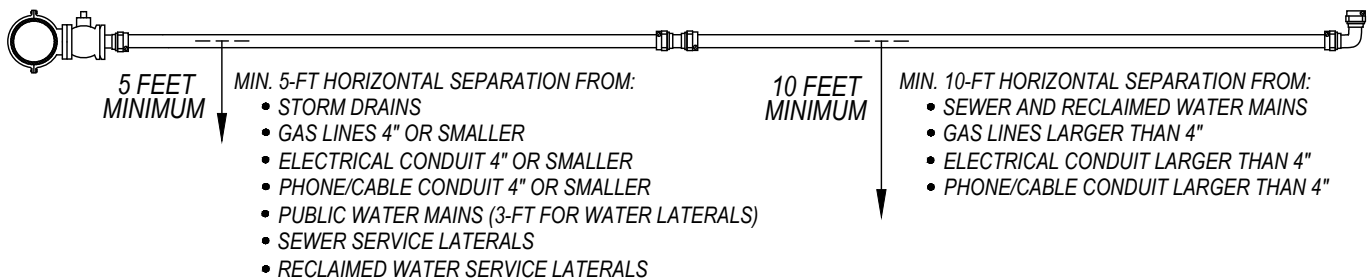

**NOTES**

1. WATER-SEWER (WATER-RECLAIMED WATER) SEPARATION SHALL BE PER THE REQUIREMENTS OF THE STATE WATER RESOURCES CONTROL BOARD.
2. IF EXISTING UTILITIES ARE REPLACED, THE NEW FACILITIES SHALL MEET THE CURRENT MINIMUM SEPARATION REQUIREMENTS.
3. IF THERE ARE DIFFERENT SEPARATION REQUIREMENTS BASED ON OTHER UTILITY REQUIREMENTS, OR LOCAL, STATE, OR FEDERAL REGULATIONS, THE STRICTER SEPARATION REQUIREMENTS SHALL PREVAIL.
4. FOR VERTICAL SEPARATION REQUIREMENTS, SEE W-22B.

CITY OF NAPA

UTILITIES DEPARTMENT

TITLE  
**HORIZONTAL SEPARATION  
 REQUIREMENTS BETWEEN PUBLIC WATER  
 FACILITIES AND OTHER UTILITIES**

DRAWN BY: DF  
 APPROVAL DATE: 09/2021  
 SCALE: NTS  
 REVISED DATE: 09/2021

CHECKED BY: SL  
 APPROVED BY: DD  
 DRAWING NO. W-22A