



EXISTING OR PROPOSED WATER MAINS, 12" AND LARGER

(MEASURED FROM OUTER EDGE OF WATER MAIN TO OUTER EDGE OF OTHER UTILITY)

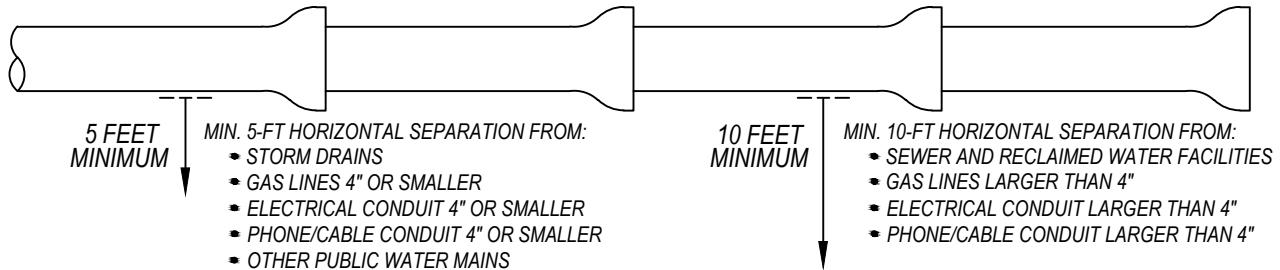


EXISTING OR PROPOSED WATER MAINS, 8" AND SMALLER

(MEASURED FROM CENTERLINE OF WATER MAIN TO OUTER EDGE OF OTHER UTILITY)

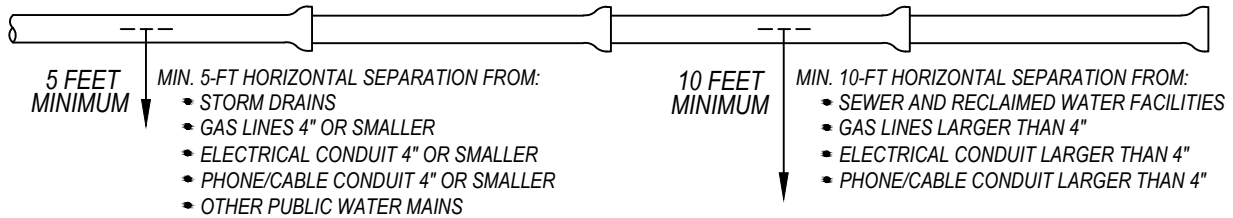

EXISTING OR PROPOSED WATER SERVICE AND FIRE HYDRANT LATERALS

(MEASURED FROM CENTERLINE OF WATER LATERAL TO OUTER EDGE OF OTHER UTILITY)

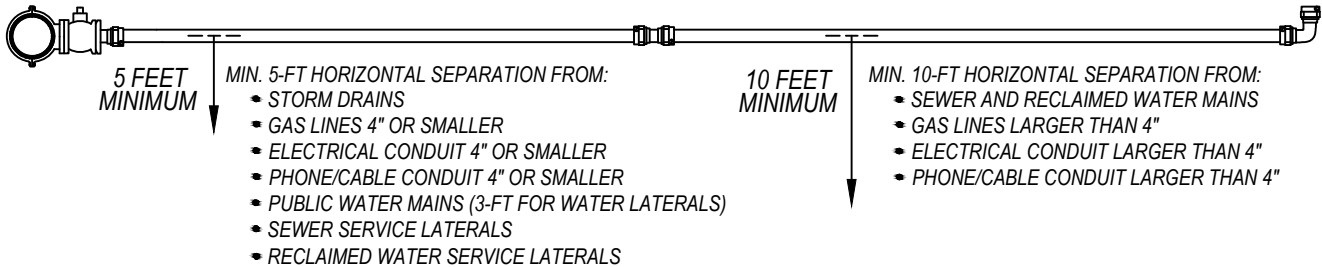

NOTES

1. WATER-SEWER (WATER-RECLAIMED WATER) SEPARATION SHALL BE PER THE REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF HEALTH SERVICES.
2. IF EXISTING UTILITIES ARE REPLACED, THE NEW FACILITIES SHALL MEET THE CURRENT MINIMUM SEPARATION REQUIREMENTS.
3. IF THERE ARE DIFFERENT SEPARATION REQUIREMENTS BASED ON OTHER UTILITY REQUIREMENTS, OR LOCAL, STATE, OR FEDERAL REGULATIONS, THE STRICTER SEPARATION REQUIREMENTS SHALL PREVAIL.
4. FOR VERTICAL SEPARATION REQUIREMENTS, SEE W-22B.

CITY OF NAPA

PUBLIC WORKS DEPARTMENT

TITLE HORIZONTAL SEPARATION REQUIREMENTS
BETWEEN PUBLIC WATER FACILITIES
AND OTHER UTILITIES

DRAWN BY: DCF
DATE: 07/2017
SCALE: NTS
FIELD NOTES:

CHECKED BY: MJH
APPROVED BY: MJH
DRAWING NO. W-22A