
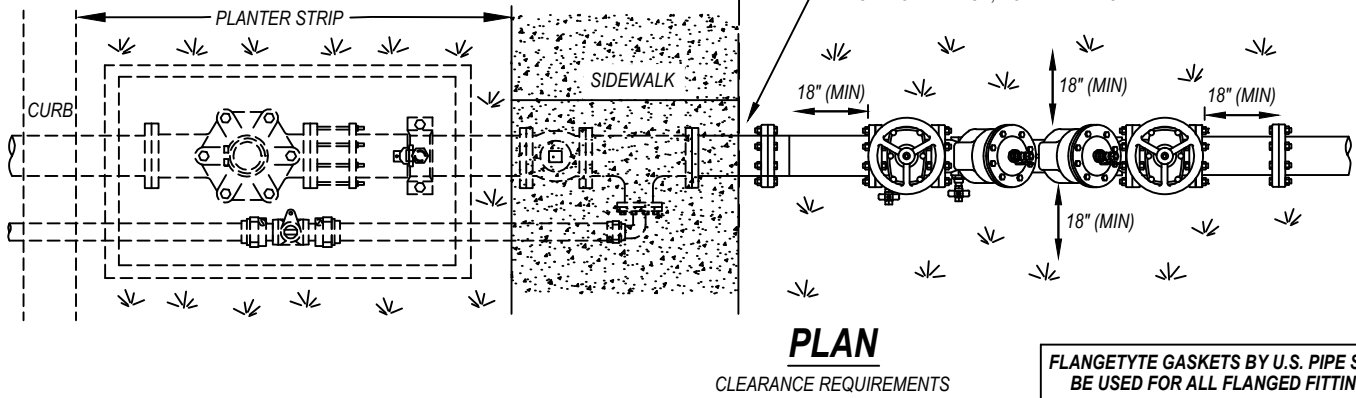


ALL JOINTS SHALL BE RESTRAINED.
 BURIED FITTINGS: MEGALUG RESTRAINTS, OR EQUAL
 EXPOSED FITTINGS: FLANGED, MEGALUG, OR VICTAULIC JOINTS

PUBLIC RIGHT-OF-WAY | PRIVATE PROPERTY

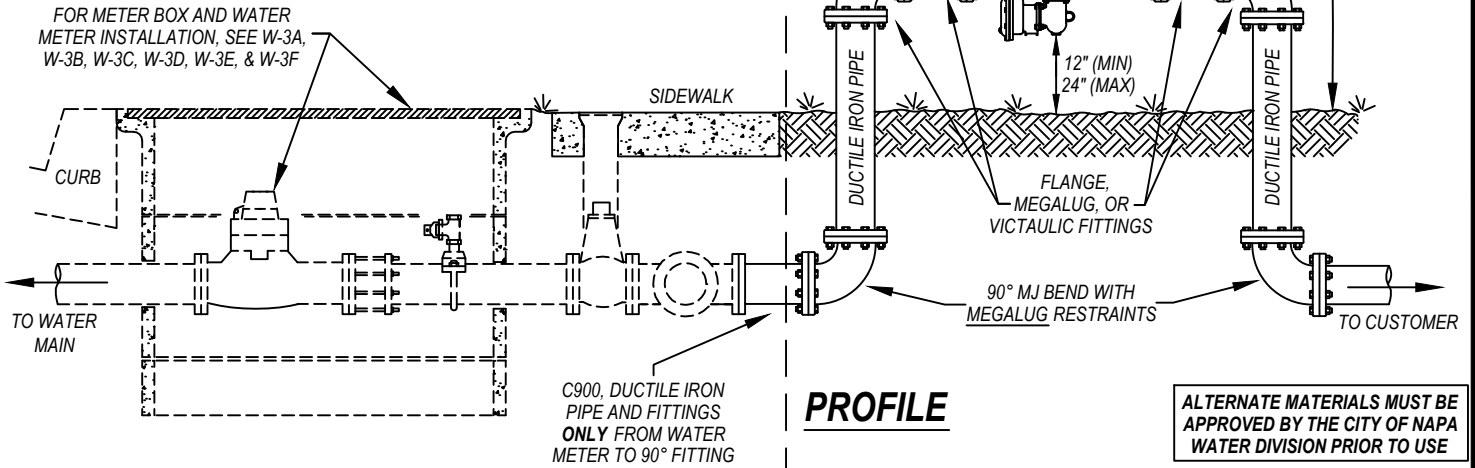

CITY OF NAPA

PUBLIC WORKS DEPARTMENT

TITLE EXTERIOR REDUCED PRESSURE
 BACKFLOW DEVICE INSTALLATION FOR
 3" TO 8" COMMERCIAL WATER SERVICES

DRAWN BY: DCF
 DATE: 07/2017
 SCALE: NTS
 FIELD NOTES:

CHECKED BY: MJH
 APPROVED BY: MJH
 DRAWING NO. W-6C.1