


**ALTERNATE MATERIALS MUST BE APPROVED BY THE CITY OF NAPA WATER DIVISION PRIOR TO USE**

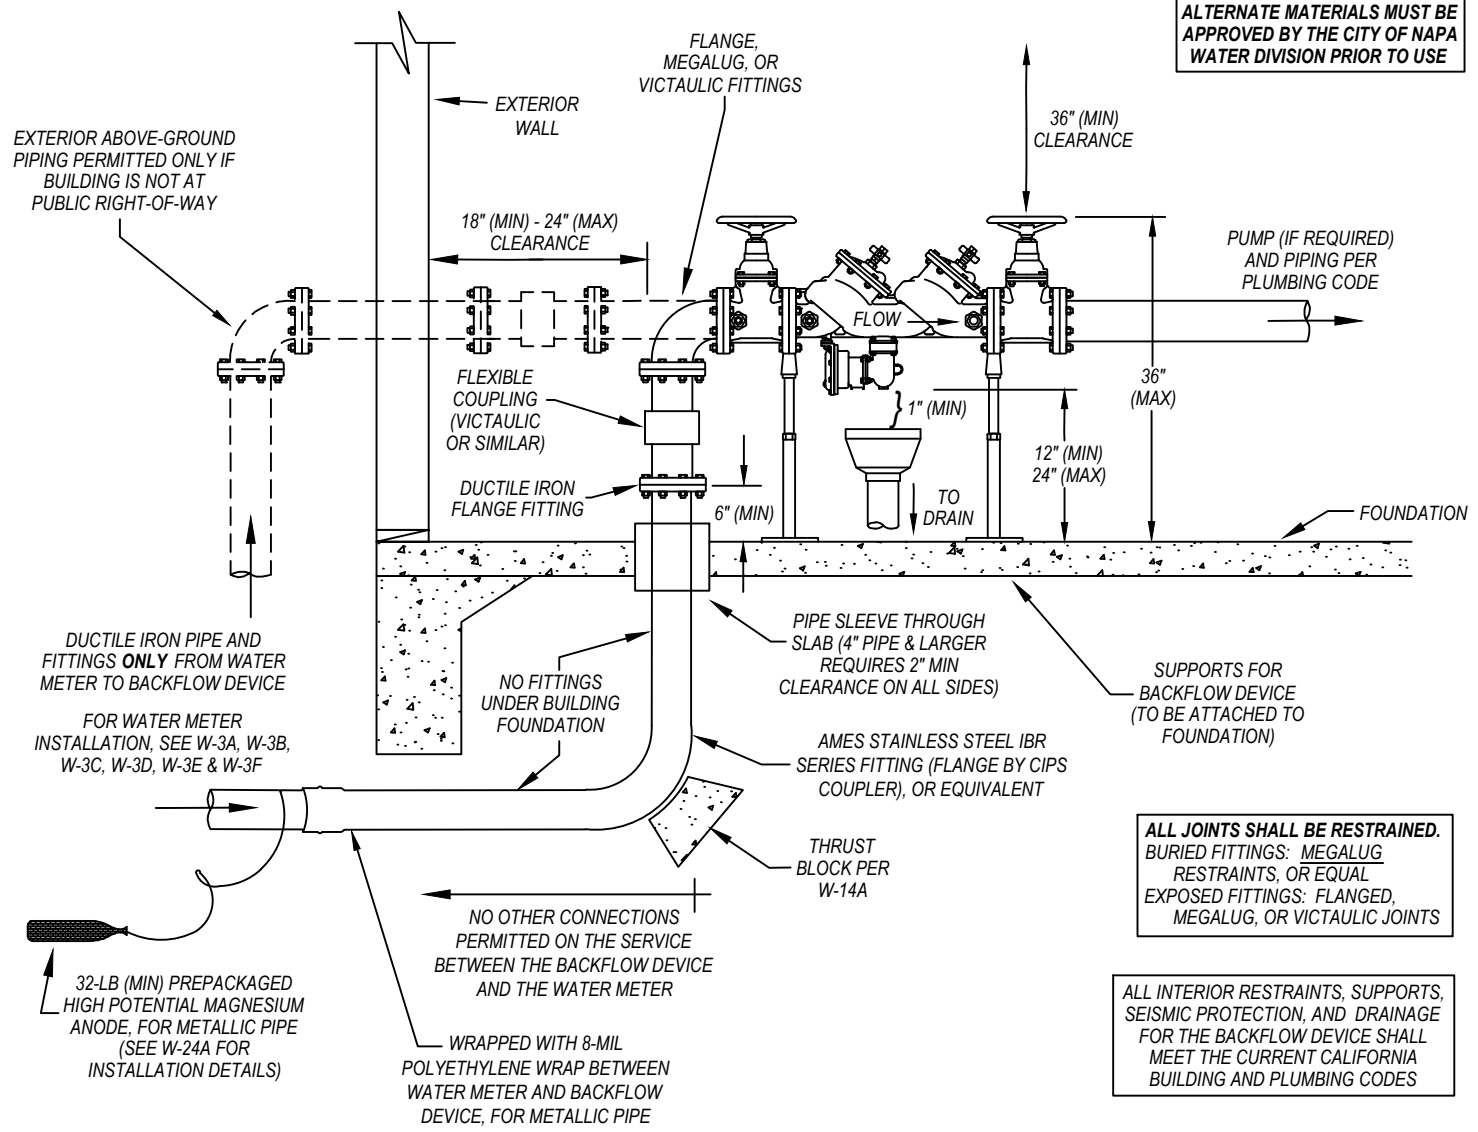

**ALL JOINTS SHALL BE RESTRAINED.**  
 BURIED FITTINGS: MEGALUG RESTRAINTS, OR EQUAL  
 EXPOSED FITTINGS: FLANGED, MEGALUG, OR VICTAULIC JOINTS

ALL INTERIOR RESTRAINTS, SUPPORTS, SEISMIC PROTECTION, AND DRAINAGE FOR THE BACKFLOW DEVICE SHALL MEET THE CURRENT CALIFORNIA BUILDING AND PLUMBING CODES

**FLANGETYTE GASKETS BY U.S. PIPE SHALL BE USED FOR ALL FLANGED FITTINGS.**

CITY OF NAPA PUBLIC WORKS DEPARTMENT

TITLE **INTERIOR REDUCED PRESSURE BACKFLOW DEVICE INSTALLATION FOR 3" TO 8" COMMERCIAL WATER SERVICES**

DRAWN BY: DCF  
 DATE: 07/2017  
 SCALE: NTS  
 FIELD NOTES:

CHECKED BY: MJH  
 APPROVED BY: MJH  
 DRAWING NO. W-6D.1