



STANDARD RESIDENTIAL SIDEWALK SECTION

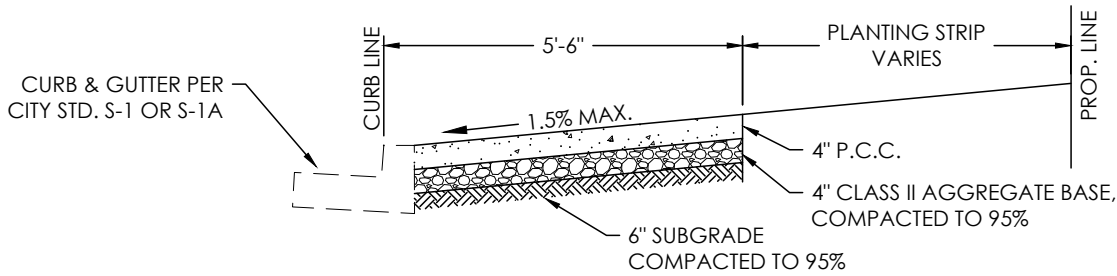

ALTERNATE RESIDENTIAL SIDEWALK SECTION
PRIOR APPROVAL FROM PUBLIC WORKS DIRECTOR REQUIRED

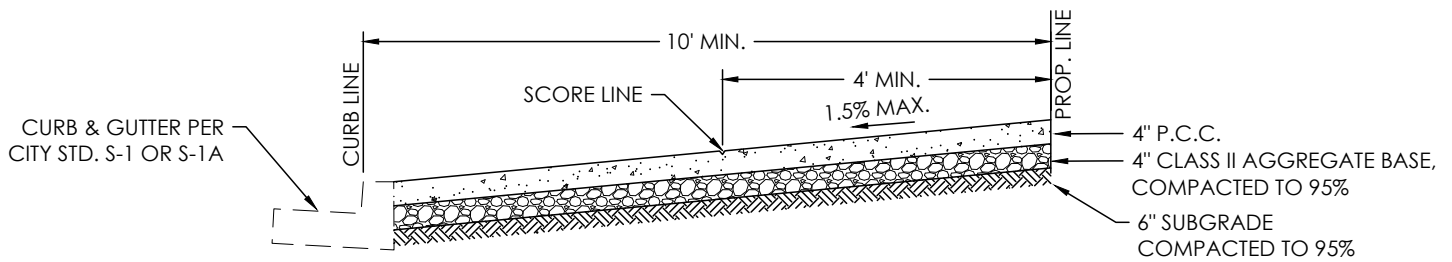

BUSINESS COMMERCIAL TYPE SIDEWALK SECTION

NOTES

1. ALL CONCRETE TO BE 4000 PSI (6 SACKS PER CUBIC YARD), 3/4" AGGREGATE.
2. NEW CLASS II AGGREGATE BASE REQUIRED FOR ALL CONSTRUCTION.
3. ALL SIDEWALKS SHALL BE 4" THICK. SIDEWALKS SHALL BE 6" THICK AT DRIVEWAYS.
4. ON STANDARD SIDEWALKS, 1/2" EXPANSION JOINTS SHALL BE INSTALLED AT 40' ON CENTER AND WEAK PLANE JOINTS SHALL BE INSTALLED MIDWAY BETWEEN EXPANSION JOINTS. ON CURB ADJACENT SIDEWALKS, EXPANSION JOINTS AND WEAK PLANE JOINTS SHALL BE ALIGNED WITH THE EXPANSION JOINTS IN THE CURB AND GUTTER.
5. TRANSVERSE SCORE LINES SHALL BE INSTALLED AT 4' INTERVALS ON RESIDENTIAL SIDEWALK AND AT 5' INTERVALS ON COMMERCIAL SIDEWALK. FOR 5.5' ADJACENT SIDEWALK, SCORE LINES SHALL BE INSTALLED AT 5' INTERVALS.
6. FOR ALL UTILITY BOXES, WEAK PLANE JOINTS SHALL BE INSTALLED ON BOTH SIDES OF THE BOX. WEAK PLANE JOINTS SHALL EXTEND THE ENTIRE WIDTH OF THE SIDEWALK, OR AS DIRECTED BY THE ENGINEER.
7. COMPACTION TESTS ARE REQUIRED ON NATIVE SUBGRADE AND CLASS II AB FOR ALL CONSTRUCTION.
8. FOR ADJACENT SIDEWALK AND BUSINESS OR COMMERCIAL SIDEWALKS, STREET TREE WELLS SHALL BE FIELD LOCATED BY THE ENGINEER PRIOR TO POURING SIDEWALK.
9. ALL SIDEWALKS SHALL MAINTAIN A 4' A.D.A. PATH OF TRAVEL WITHOUT OBSTRUCTIONS.
10. SIDEWALKS ADJACENT TO EXISTING CURB SHALL BE DOWELLED PER DETAIL S-4B.

CITY OF NAPA

PUBLIC WORKS DEPARTMENT

STANDARD DETAILS
 SIDEWALK SECTIONS

DRAWN BY: LFM
 APPROVAL DATE: 06/2018
 SCALE: NONE
 REVISED DATE: 08/2021

CHECKED BY: IHH
 APPROVED BY: JBL
 DRAWING NO.

S-4