



SHOULDER BACKING

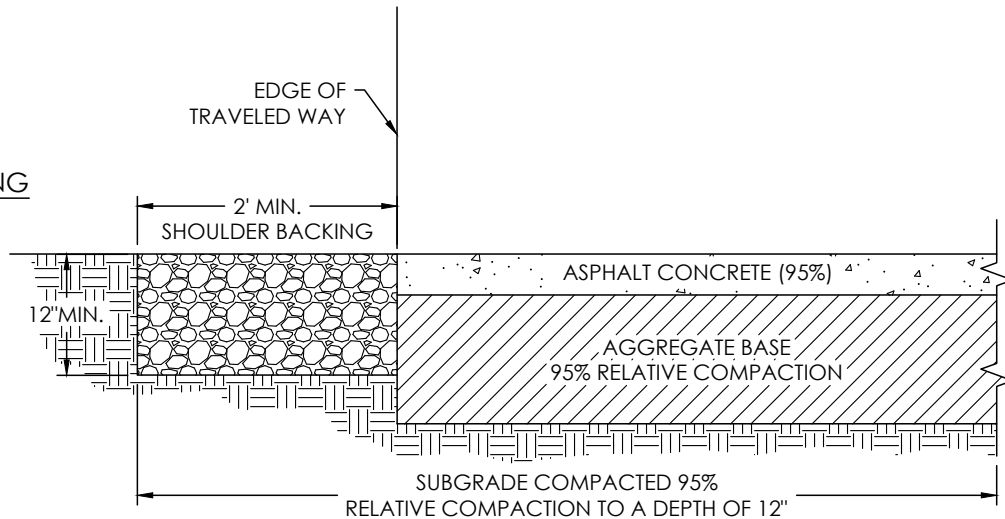

FLUSH VERTICAL CURB

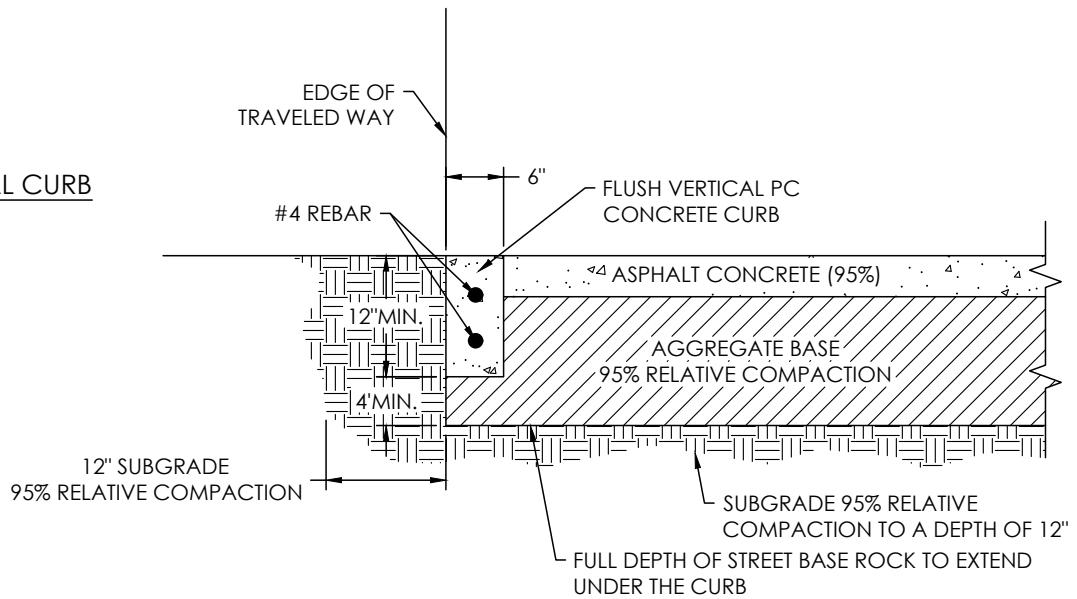

NOTES

1. ALL UNSUPPORTED PAVEMENT STRUCTURAL SECTION EDGES SHALL INCLUDE EDGE PROTECTION PER THIS DETAIL.
2. ALL CONCRETE SHALL BE 4000 PSI (6 SACKS PER CUBIC YARD), 3/4" MAX AGGREGATE.
3. CONCRETE SHALL BE BRUSH FINISHED PARALLEL TO FACE OF CURB.
4. ALL CURBS SHALL BE BACKFILLED BEFORE STREET IS ROCKED AND PAVED.
5. CLASS 2 AGGREGATE BASE, SUBGRADE AND FILL MATERIAL, IF ANY, SHALL HAVE A MINIMUM OF 95% RELATIVE COMPACTION UNDER CURBS.
6. ON STRAIGHT RUN OF CURB, 1/2 INCH EXPANSION JOINTS SHALL BE INSTALLED ON 40 FOOT C.C. AND WEAK PLANE JOINTS INSTALLED MIDWAY BETWEEN EXPANSION JOINTS.
7. SUBGRADE SHALL EXTEND UNDER ALL SHOULDER BACKING AND TO ONE FOOT BEHIND FLUSH CURB.

CITY OF NAPA

PUBLIC WORKS DEPARTMENT

PAVEMENT SECTION
EDGE PROTECTION

DRAWN BY: LFM
 APPROVAL DATE: 06/2018
 SCALE: NONE
 REVISED DATE: 08/2021

CHECKED BY: IHH
 APPROVED BY: JBL
 DRAWING NO. S-10