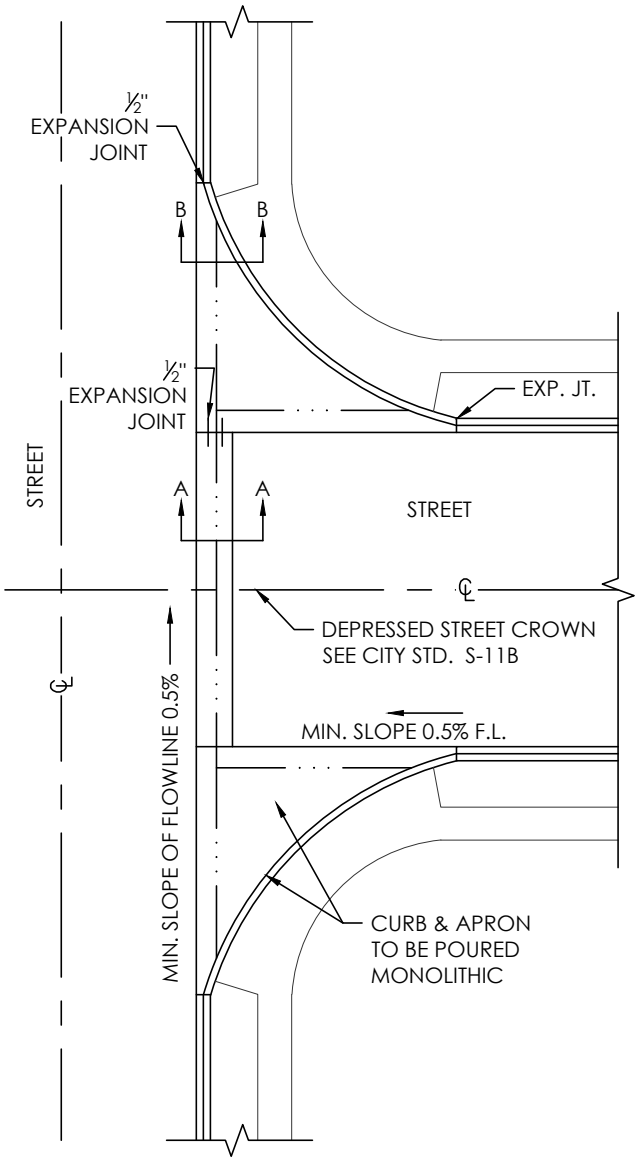

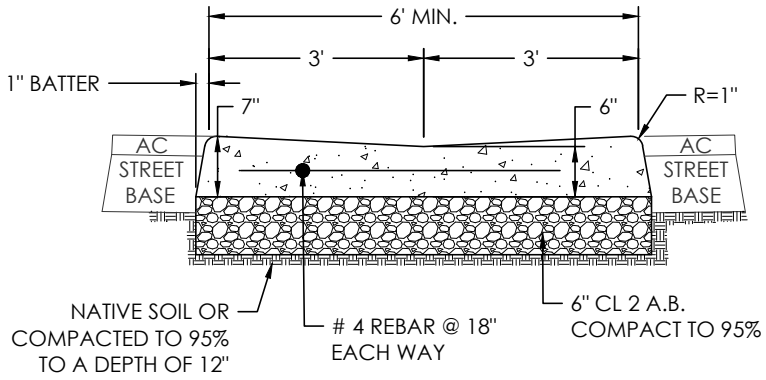

SECTION A-A

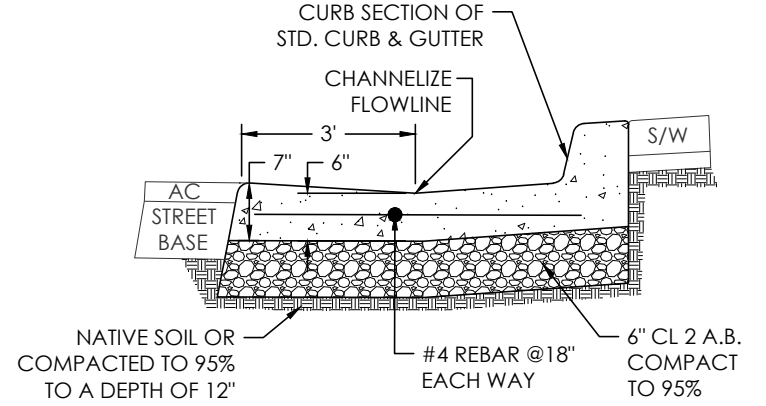

SECTION B-B

NOTES

1. ALL CONCRETE SHALL BE 4000 PSI (6 SACKS PER CUBIC YARD), 3/4" AGGREGATE.
2. CONCRETE SHALL BE BRUSH FINISHED PARALLEL TO FACE OF CURB.
3. SEE CITY STD S-4B, CONCRETE CONNECTION DETAIL.

CITY OF NAPA — PUBLIC WORKS DEPARTMENT

STANDARD CROSS GUTTER

DRAWN BY:	LFM	CHECKED BY:	IHH
APPROVAL DATE:	06/2018	APPROVED BY:	JBL
SCALE:	NONE	DRAWING NO.	S-11A
REVISED DATE:	08/2021		